


NOTES:

1. BOLT CIRCLE DIAMETERS SHALL MATCH LIGHT STANDARD. CHECK BEFORE POURING.

BOLT CIRCLE

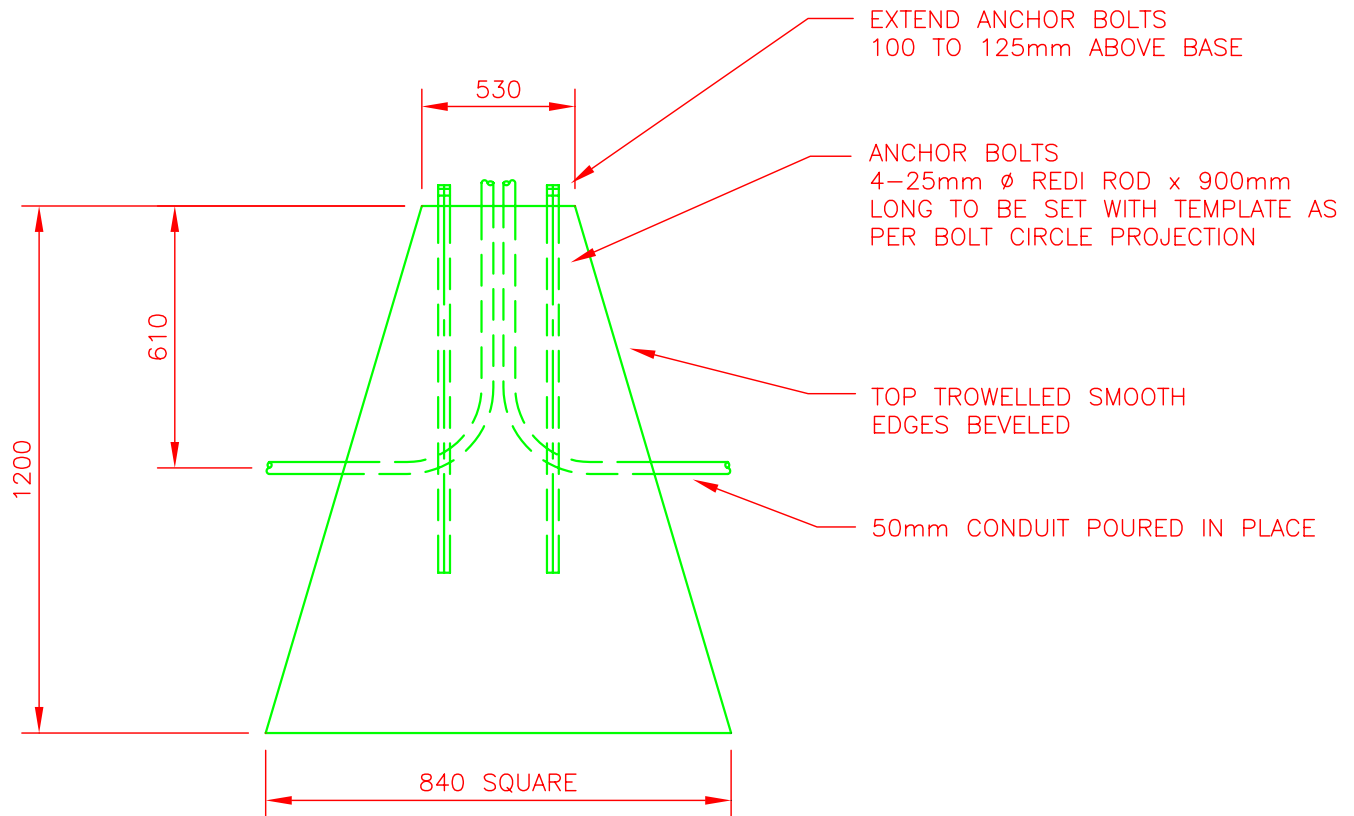

ELEVATION

NOTES:

1. PROVIDE 150mm DEPTH OF GRANULAR BASE COMPACTED TO 100% STANDARD PROCTOR DENSITY BELOW BASE.
2. FOR STANDARDS WHERE SERVICE BASES ARE REQUIRED, INSTALL SERVICE CONDUIT TO B.C. HYDRO STANDARDS.

UNITS ARE IN MILLIMETERS
UNLESS OTHERWISE NOTED

				STANDARD LIGHT POLE BASE		
2	City	Drawings revised	02/99	<i>Date:</i> February 12/99	<i>Scale:</i> N.T.S	<i>Dwg. No.</i> G-5
1	Usi	Original drawings created	04/96	<i>Drawn by:</i> Bob Smith	<i>Cad file:</i> c:\..\drawings\standard\By_G5	
No.	By	Revisions	Date			