


CROSS SECTION

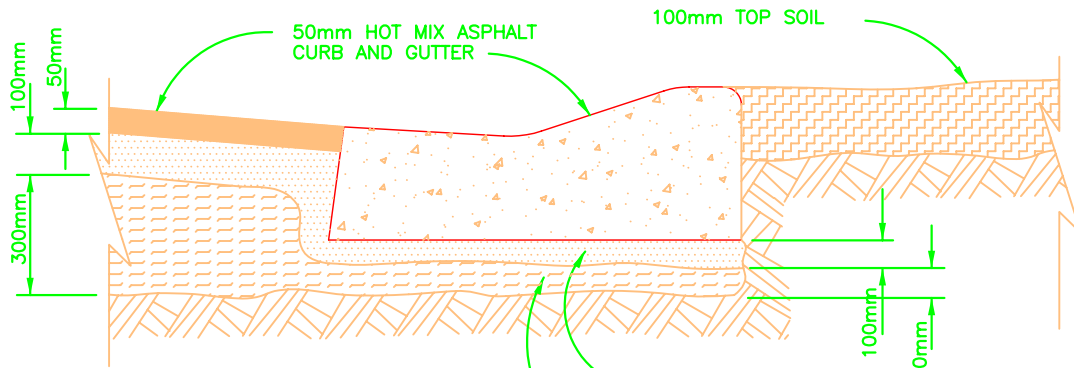

NOTE:

CONCRETE - 30 Mpa. at 28 days
 Slump - 25 to 75mm
 Air entrainment - 6 to 8%
 Min. 98% Std. Proctor Density for all travelled areas
 Install contraction & surface joints alternately at every 1.5m
 Install one 300mm X 13mm dowel every 1.5m if sidewalk is poured separately

19mm MINUS GRANULAR MATERIAL

75mm MINUS GRANULAR MATERIAL

MOUNTABLE CURB AND GUTTER

2	City	Drawings revised	02/99
1	Usf	Original drawings created	04/96
No.	By	Revisions	Date

Date: March 09, 1999	Scale: N.T.S	Dwg. No. C-1A
Drawn by: Bob Smith	Cad file: c:\..\drawings\standard\By-C1	